


**GENERAL NOTE:**

WATER SERVICE SHALL BE KEPT AT LEAST TWENTY-FIVE (25) FEET AWAY FROM INDIVIDUAL SEWAGE DISPOSAL SYSTEM OR CESSPOOLS. LINES CLOSER THAN THE ALLOWABLE DISTANCE SHALL BE ENCASED IN SCHEDULE 40 PVC PIPE. INTERMEDIATE JOINTS SHALL BE JOINED TOGETHER AND SEALED TO FORM A WATER TIGHT CONNECTION. END SECTIONS SHALL BE FITTED WITH MECHANICAL DEVICE TO MAKE THE SPACE BETWEEN SERVICE PIPE AND ENCASEMENT WATER TIGHT.

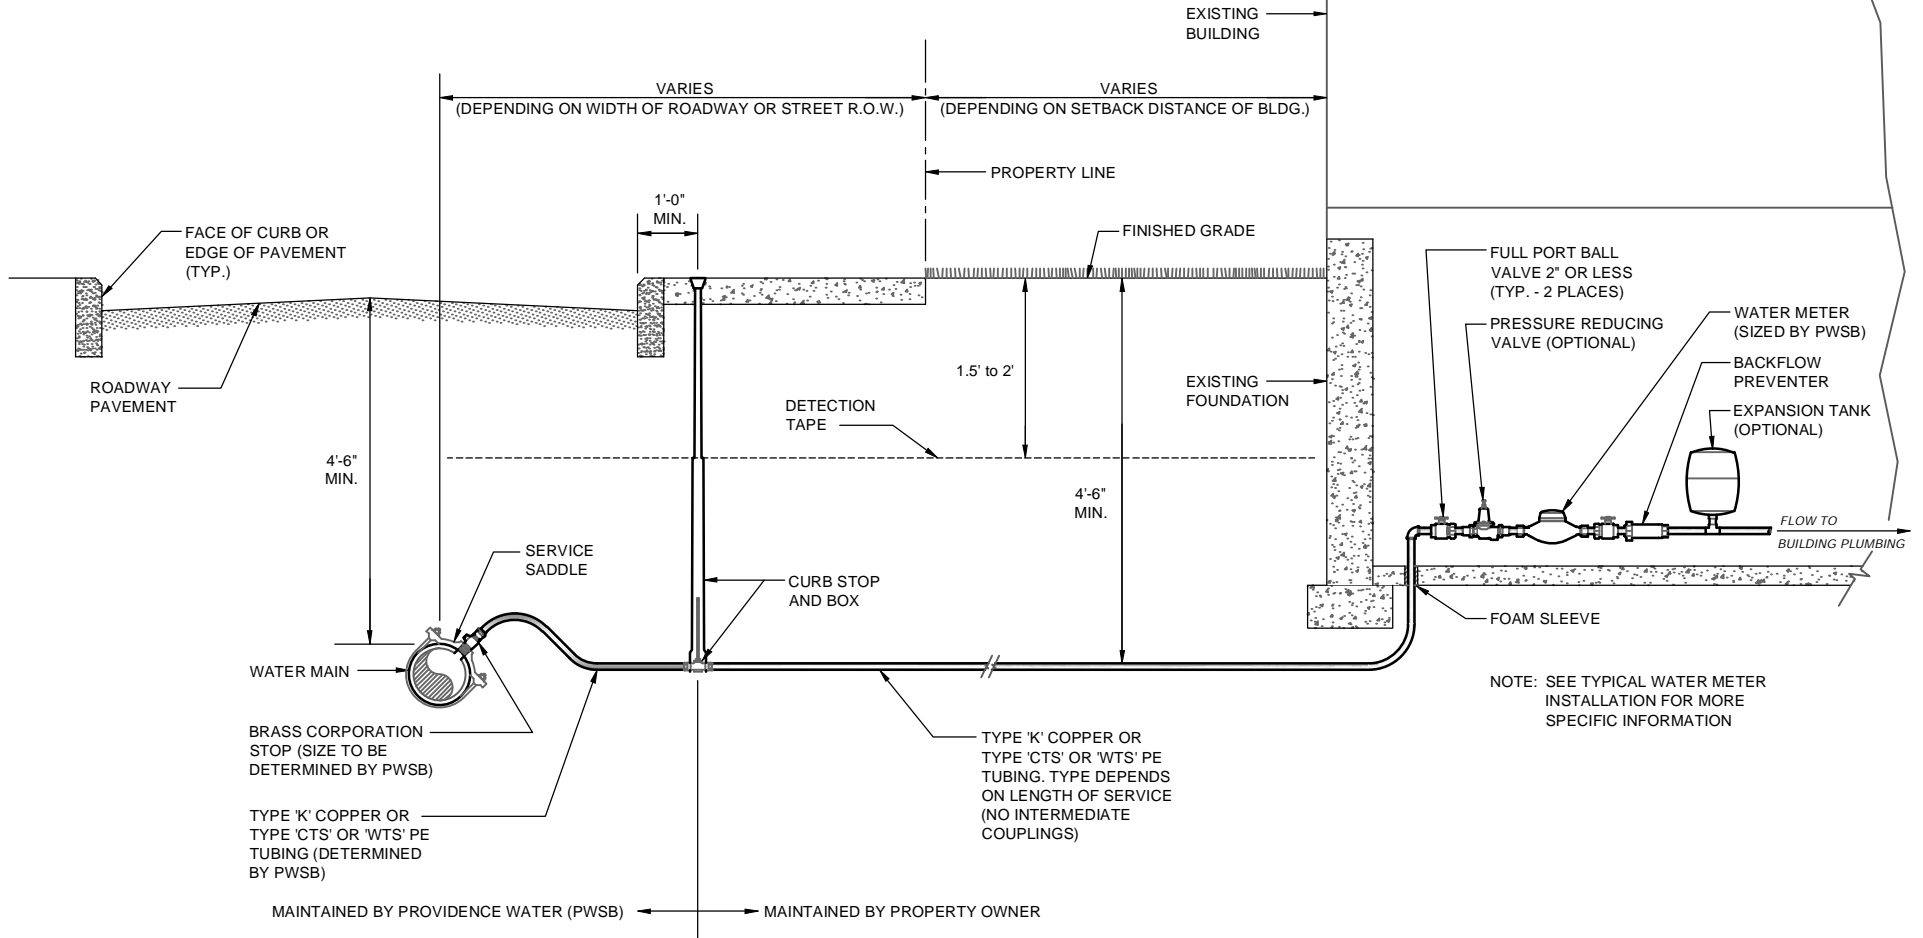

**RESIDENTIAL WATER SERVICE CONNECTION SCHEMATIC - ELEVATION VIEW**

NOT TO SCALE

*Patricia R. V...*  
 Senior Manager of Engineering      Date: 9-28-12

